

Certificate of test

Particle size distribution (by washing and sieving)


Tested in accordance with BS EN 933-1: 2012
 Prepared in accordance with BS EN 932-2: 1999

Laboratory Reference: OCMT-7140-3195	Certificate Reference: OCMT-7140-3195-A03-WS
Client: Towens of Weston Ltd	Issue Number: 1.1
Clients Address: Plot 2, Warne Road, , Weston Super Mare, BS23 3UU	Client Order Number: Towens-Monthly Westonzoyland
Site: Westonzoyland	

Sample Reference: 0/20mm Reclaimed	Sample Certificate: Yes - See enclosed
Source: Ex-site	Date Sampled: 19/1/2024
Location of Sample on Site: Stock Pile	Sampled by: ST (OEMA)
Material Description: 0/20mm Reclaimed All-In Aggregate	Date Received: 19/01/2024
Clients Indicated Specification: EN 12620: 0/20 Gravel/Recycled (GA85)	Date Tested: 31/01/2024


Result:

ISO 565 Sieve Aperture (mm)	Percentage Passing (%)	Specification (Passing)	
		Lower (%)	Upper (%)
125.00	100		
80.00	100		
63.00	100		
40.00	100	100	100
31.50	100	98	100
20.00	97	85	99
16.00	90		
14.00	83		
10.00	73	50	90
8.00	66		
6.30	59		
4.00	48		
2.80	45		
2.00	39	20	60
1.00	28		
0.500	22		
0.250	11		
0.125	3		
0.063	1.5	0	3

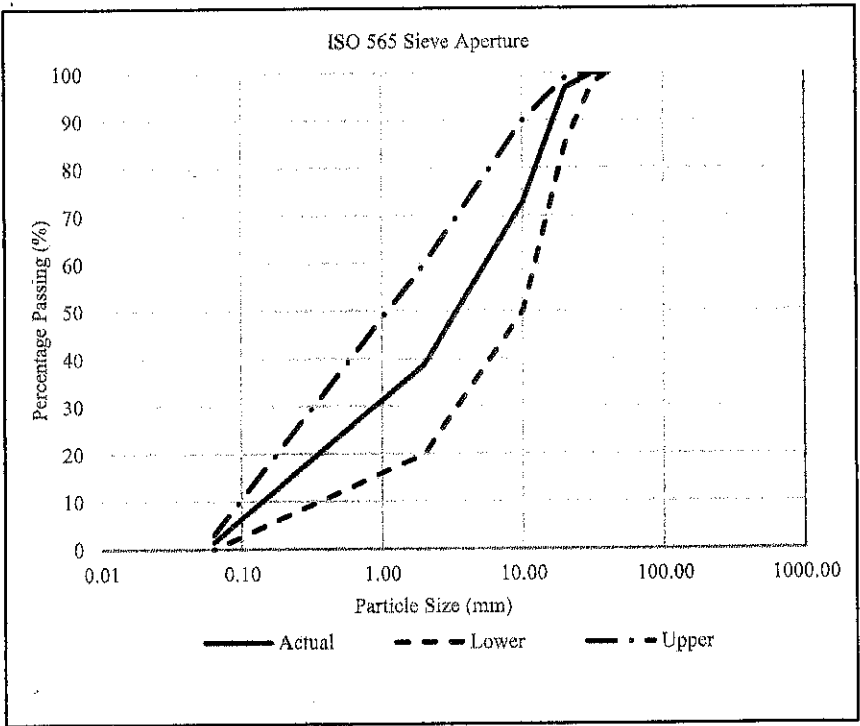

Fractions where required (differences in values passing selected sieves)			
Uniformity Co-efficient			
D100 (mm)	31.5		
D60 (mm)	6.54		
D10 (mm)	0.234		
U/C (nr.)	27.9		

Remarks: **This sample complies with the clients indicated grading specification**

Approved By: 
 Martin Slater - Material Technologist
 Date Approved: **14/02/2024**
 Sheet Ref: **A03-WS-Rev6-Nov23**

Refer to the remarks section for any additions, deviations or exclusions from the stated test & preparation methods.
 The results within this test report are representative of the samples submitted at the time of analysis.
 This test report should not be reproduced, except in full, without the express permission of the Issuing laboratory.
 Bulk samples are retained for a period of 28 days from receipt.
 Any opinions or interpretations indicated are outside the scope of our accreditation.
 Simplified decision rules apply to any statements of compliance made on the test report
 Where a sample has not been taken by Oema Chem Ltd, the test results apply to the sample as received

Oema Chem Limited
T/A OEMA
 Unit 1 - Building 267A
 Commercial Road
 Christchurch
 Dorset
 BH23 6NW



10818